

Certificate: 1044

Sample ID: 2310SMAZ0167.0462  
Batch #: 10

## Hemp THCa Flower

Batch #: 10  
Strain: 00008 Gelato Cake  
Parent Batch #:  
Sample Collected:  
Published: 10/30/2023

Sample ID: 2310SMAZ0167.0462  
Amount Received: 5.4 g  
Sample Type: Flower - Cured  
Received: 10/18/2023



## COMPLIANCE FOR RETAIL

### Regulated Analytes

Cannabinoid Profile (Q3) <b>Tested</b>	Microbial Contaminants <b>Not Tested</b>	Residual Solvents <b>Not Tested</b>
Pesticides, Fungicides, and Growth Regulators <b>Pass</b>	Mycotoxins <b>Not Tested</b>	Heavy Metals <b>Pass</b>

**11.970%**  
Total THC

**<LOQ**  
Total CBD

### Additional Analytes (Not Regulated)

Terpenes Total (Q3) <b>Not Tested</b>	Moisture Analysis (Q3) <b>Not Tested</b>	Water Activity (Q3) <b>Not Tested</b>
Filth & Foreign (Q3) <b>Not Tested</b>	Homogeneity (Q3) <b>Not Tested</b>	

**ND**  
CBN

**0.068%**  
CBG

**13.804%**  
Total Cannabinoids (Q3)


Ahmed Munshi

Technical Laboratory Director

Smithers CTS Arizona LLC  
734 W Highland Avenue, 2nd Floor  
Phoenix, AZ 85013  
(602) 806-6930



Accreditation #: 103104



Certificate: 1044

Sample ID: 2310SMAZ0167.0462  
Batch #: 10

### Cannabinoid Profile

HPLC

Tested

### Sample Prep

Batch Date: 10/19/2023  
SOP: 418.AZ  
Batch Number: 197

### Sample Analysis

Date: 10/20/2023  
SOP: 417.AZ - HPLC  
Sample Weight: 0.103 g  
Volume: 40 mL

Analyte	LOD (mg/g)	LOQ (mg/g)	Dil.	Actual % (w/w)	mg/g	Qualifier
CBC	0.125	0.379	1	ND	ND	
CBD	0.125	0.379	1	ND	ND	
CBDA	0.125	0.379	1	<LOQ	<LOQ	
CBDV	0.125	0.379	1	ND	ND	
CBG	0.125	0.379	1	0.068	0.684	
CBGA	0.125	0.379	1	0.166	1.663	
CBN	0.125	0.379	1	ND	ND	
d8-THC	0.125	0.379	1	ND	ND	
d9-THC	0.125	0.379	1	0.271	2.712	
THCA	0.125	0.379	1	12.998	129.978	
THCV	0.125	0.379	1	ND	ND	

Cannabinoid Totals	Actual % (w/w)	mg/g	Qualifier
Total THC	11.970	119.702	
Total CBD	<LOQ	<LOQ	
Total Cannabinoids	13.804	138.037	Q3

Total THC = THC + (0.877 x THCA) and Total CBD = CBD + (0.877 x CBDA)  
ND = Not Detected, NT = Not Tested, <LOQ = Below Limit of Quantitation

Ahmed Munshi


Technical Laboratory Director

Smithers CTS Arizona LLC  
734 W Highland Avenue, 2nd Floor  
Phoenix, AZ 85013  
(602) 806-6930



Accreditation #: 103104

The product associated with this COA has been tested by Smithers CTS Arizona LLC, using validated state certified testing methodologies as required by Arizona state law. This COA is governed by the terms and conditions listed on: <https://www.smithers.com/arizona-terms-conditions>



Certificate: 1044

Sample ID: 2310SMAZ0167.0462  
Batch #: 10

### Heavy Metals

ICP-MS

**Pass**


### Sample Prep

Batch Date: 10/19/2023  
SOP: 428.AZ  
Batch Number: 188

### Sample Analysis

Date: 10/19/2023  
SOP: 428.AZ - ICP-MS  
Sample Weight: 0.2480 g  
Volume: 6 mL

Analyte	LOD (ppm)	LOQ (ppm)	Dil.	Action Limit (ppm)	Results (ppm)	Qualifier
Arsenic	0.016	0.161	10	0.4	ND	
Cadmium	0.016	0.161	10	0.4	ND	
Lead	0.016	0.403	10	1	ND	
Mercury	0.016	0.081	10	0.2	ND	

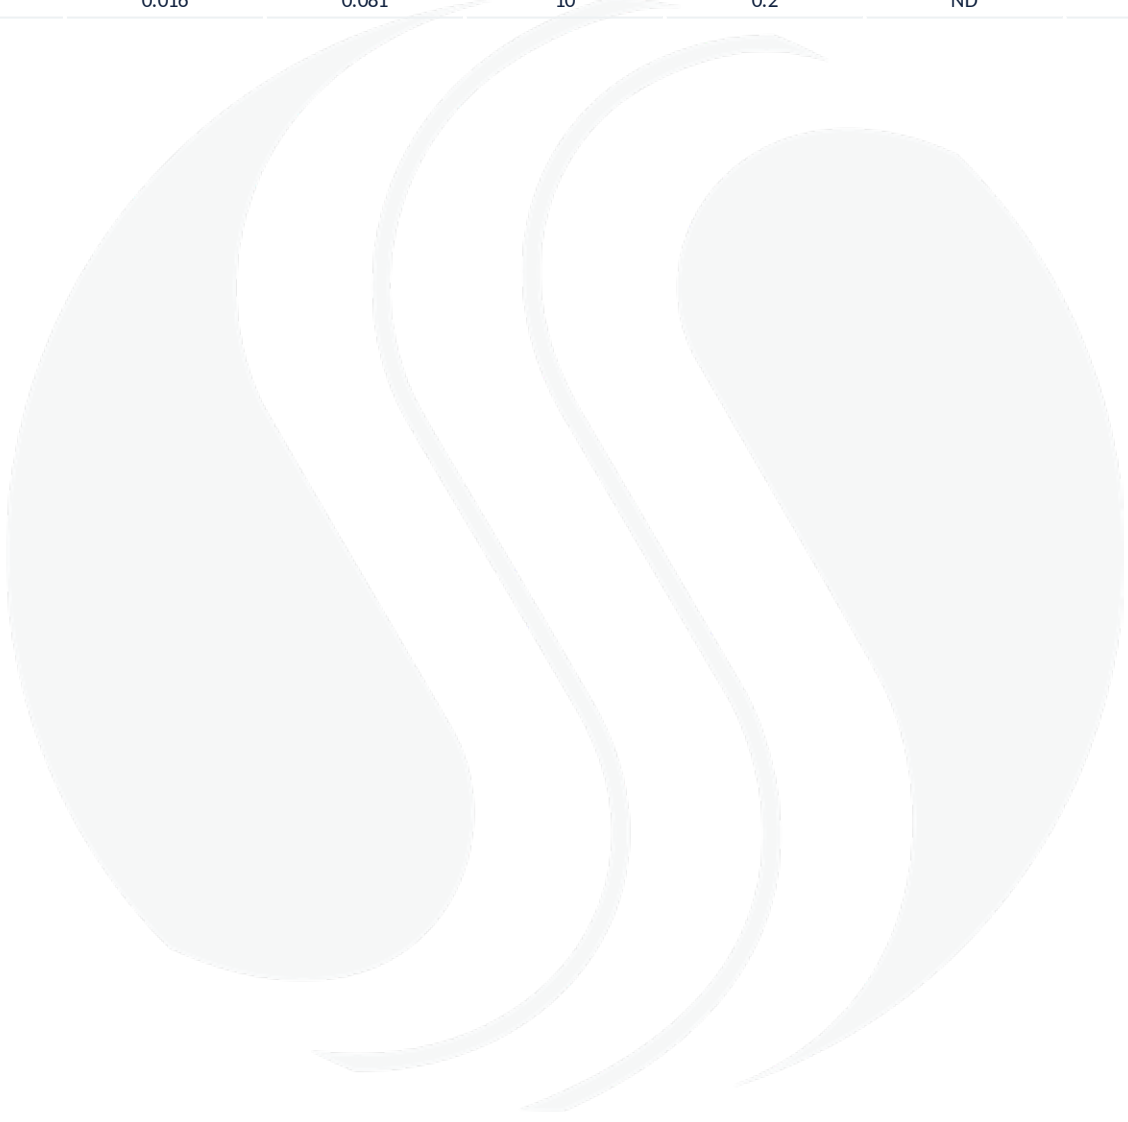

**Ahmed Munshi**


Technical Laboratory Director

**Smithers CTS Arizona LLC**  
734 W Highland Avenue, 2nd Floor  
Phoenix, AZ 85013  
(602) 806-6930



Accreditation #: 103104

The product associated with this COA has been tested by Smithers CTS Arizona LLC, using validated state certified testing methodologies as required by Arizona state law. This COA is governed by the terms and conditions listed on: <https://www.smithers.com/arizona-terms-conditions>



Certificate: 1044

Sample ID: 2310SMAZ0167.0462  
Batch #: 10

**Pesticides, Fungicides, and  
Growth Regulators**  
LC-MS/MS **Pass**

**Sample Prep**

Batch Date: 10/18/2023  
SOP: 432.AZ  
Batch Number: 178

**Sample Analysis**


Date: 10/19/2023  
SOP: 424.AZ - LC-MS/MS  
Sample Weight: 0.5555 g  
Volume: 12.5 mL

Analyte	LOD / LOQ (ppm)	Dil.	Action Limit (ppm)	Results (ppm)	Qualifier	Analyte	LOD / LOQ (ppm)	Dil.	Action Limit (ppm)	Results (ppm)	Qualifier
Abamectin B1a	0.075 / 0.225	1	0.5	ND	I1	Hexythiazox	0.150 / 0.450	1	1	ND	M2
Acephate	0.060 / 0.180	1	0.4	ND		Imazalil	0.030 / 0.090	1	0.2	ND	
Acetamiprid	0.030 / 0.090	1	0.2	ND		Imidacloprid	0.060 / 0.180	1	0.4	ND	
Aldicarb	0.060 / 0.180	1	0.4	ND		Kresoxim-methyl	0.060 / 0.180	1	0.4	ND	
Azoxystrobin	0.030 / 0.090	1	0.2	ND		Malathion	0.030 / 0.090	1	0.2	ND	
Bifenazate	0.030 / 0.090	1	0.2	ND		Metaxalyl	0.030 / 0.090	1	0.2	ND	
Bifenthrin	0.030 / 0.090	1	0.2	ND	M2	Methiocarb	0.030 / 0.090	1	0.2	ND	M1
Boscalid	0.060 / 0.180	1	0.4	ND	M1	Methomyl	0.060 / 0.180	1	0.4	ND	
Carbaryl	0.030 / 0.090	1	0.2	ND		Myclobutanil	0.030 / 0.090	1	0.2	ND	M1
Carbofuran	0.030 / 0.090	1	0.2	ND		Naled	0.075 / 0.225	1	0.5	ND	
Chlorantraniliprole	0.030 / 0.090	1	0.2	ND	M1	Oxamyl	0.150 / 0.450	1	1	ND	
Chlorfenapyr	0.150 / 0.450	1	1	ND	I1, M1	Pacllobutrazol	0.060 / 0.180	1	0.4	ND	M1
Chlorpyrifos	0.030 / 0.090	1	0.2	ND	M2	Permethrins	0.030 / 0.090	1	0.2	ND	I1, M2
Clofentezine	0.030 / 0.090	1	0.2	ND		Phosmet	0.030 / 0.090	1	0.2	ND	
Cyfluthrin	0.150 / 0.450	1	1	ND		Piperonyl Butoxide	0.300 / 0.900	1	2	ND	M2
Cypermethrin	0.150 / 0.450	1	1	ND	M2	Prallethrin	0.030 / 0.090	1	0.2	ND	
Daminozide	0.150 / 0.450	1	1	ND		Propiconazole	0.060 / 0.180	1	0.4	ND	
Diazinon	0.030 / 0.090	1	0.2	ND		Propoxur	0.030 / 0.090	1	0.2	ND	
Dichlorvos	0.015 / 0.045	1	0.1	ND		Pyrethrins	0.126 / 0.377	1	1	ND	I1, M1
Dimethoate	0.030 / 0.090	1	0.2	ND		Pyridaben	0.030 / 0.090	1	0.2	ND	M2
Ethoprophos	0.030 / 0.090	1	0.2	ND		Spinosad	0.030 / 0.090	1	0.2	ND	M2
Etofenprox	0.060 / 0.180	1	0.4	ND		Spiromesifen	0.030 / 0.090	1	0.2	ND	
Etoxazole	0.030 / 0.090	1	0.2	ND		Spirotetramat	0.030 / 0.090	1	0.2	ND	
Fenoxycarb	0.030 / 0.090	1	0.2	ND		Spiroxamine	0.060 / 0.180	1	0.4	ND	
Fenpyroximate	0.060 / 0.180	1	0.4	ND	M2	Tebuconazole	0.060 / 0.180	1	0.4	ND	
Fipronil	0.060 / 0.180	1	0.4	ND		Thiacloprid	0.030 / 0.090	1	0.2	ND	
Fonicamid	0.150 / 0.450	1	1	ND		Thiamethoxam	0.030 / 0.090	1	0.2	ND	
Fludioxonil	0.060 / 0.180	1	0.4	ND	M1	Trifloxystrobin	0.030 / 0.090	1	0.2	ND	M2

Ahmed Munshi  
Technical Laboratory Director

Smithers CTS Arizona LLC  
734 W Highland Avenue, 2nd Floor  
Phoenix, AZ 85013  
(602) 806-6930





Certificate: 1044

Sample ID: 2310SMAZ0167.0462  
Batch #: 10

### Qualifier Legend

- B1** The target analyte detected in the calibration is at or above the limit of quantitation, but the sample result for potency testing, is below the limit of quantitation.
- B2** The target analyte detected in the calibration blank, or the method blank is at or above the limit of quantitation, but the sample result when testing for pesticides, fungicides, herbicides, growth regulators, heavy metals, or residual solvents, is below the maximum allowable concentration for the analyte.
- D1** The limit of quantitation and the sample results were adjusted to reflect sample dilution.
- I1** The relative intensity of a characteristic ion in a sample analyte exceeded the acceptance with respect to the reference spectra, indicating interference.
- L1** When testing for pesticides, fungicides, herbicides, growth regulators, heavy metals, or residual solvents, the percent recovery of a laboratory control sample is greater than the acceptance limits, but the sample's target analytes were not detected above the maximum allowable concentrations for the analytes in the sample.
- M1** The recovery from the matrix spike was high, but the recovery from the laboratory control sample was within acceptance criteria.
- M2** The recovery from the matrix spike was low, but the recovery from the laboratory control sample was within acceptance criteria.
- M3** The recovery from the matrix spike was unusable because the analyte concentration was disproportionate to the spike level, but the recovery from the laboratory control sample was within acceptance criteria.
- M4** The analysis of a spiked sample required a dilution such that the spike recovery calculation does not provide useful information, but the recovery from the associated laboratory control sample was within acceptance criteria.
- M5** The analyte concentration was determined by the method of standard addition, in which the standard is added directly to the aliquots of the analyzed sample.
- M6** A description of the variance is described in the final report of testing according to R9-17- 404.06(B)(3)(d)(ii).
- Q1** Sample integrity was not maintained.
- Q2** The sample is heterogeneous, and sample homogeneity could not be readily achieved using routine laboratory practices.
- Q3** Testing result is for informational purposes only and cannot be used to satisfy dispensary testing requirements in R9-17-317.01(A) or labeling requirements in R9-17-317.
- R1** The relative percent difference for the laboratory control sample and duplicate exceeded the limit, but the recovery was within acceptance criteria.
- R2** The relative percent difference for a sample and duplicate exceeded the limit.
- V1** The recovery from continuing calibration verification standards exceeded the acceptance limits, but the sample's target analytes were not detected above the maximum allowable for the analytes in the sample.

### Notes:

Ahmed Munshi

Technical Laboratory Director

Smithers CTS Arizona LLC  
734 W Highland Avenue, 2nd Floor  
Phoenix, AZ 85013  
(602) 806-6930



Accreditation #: 103104